




CITY OF LODI

PUBLIC WORKS DEPARTMENT

1" WATER SERVICE METERED W/ 60W ERT

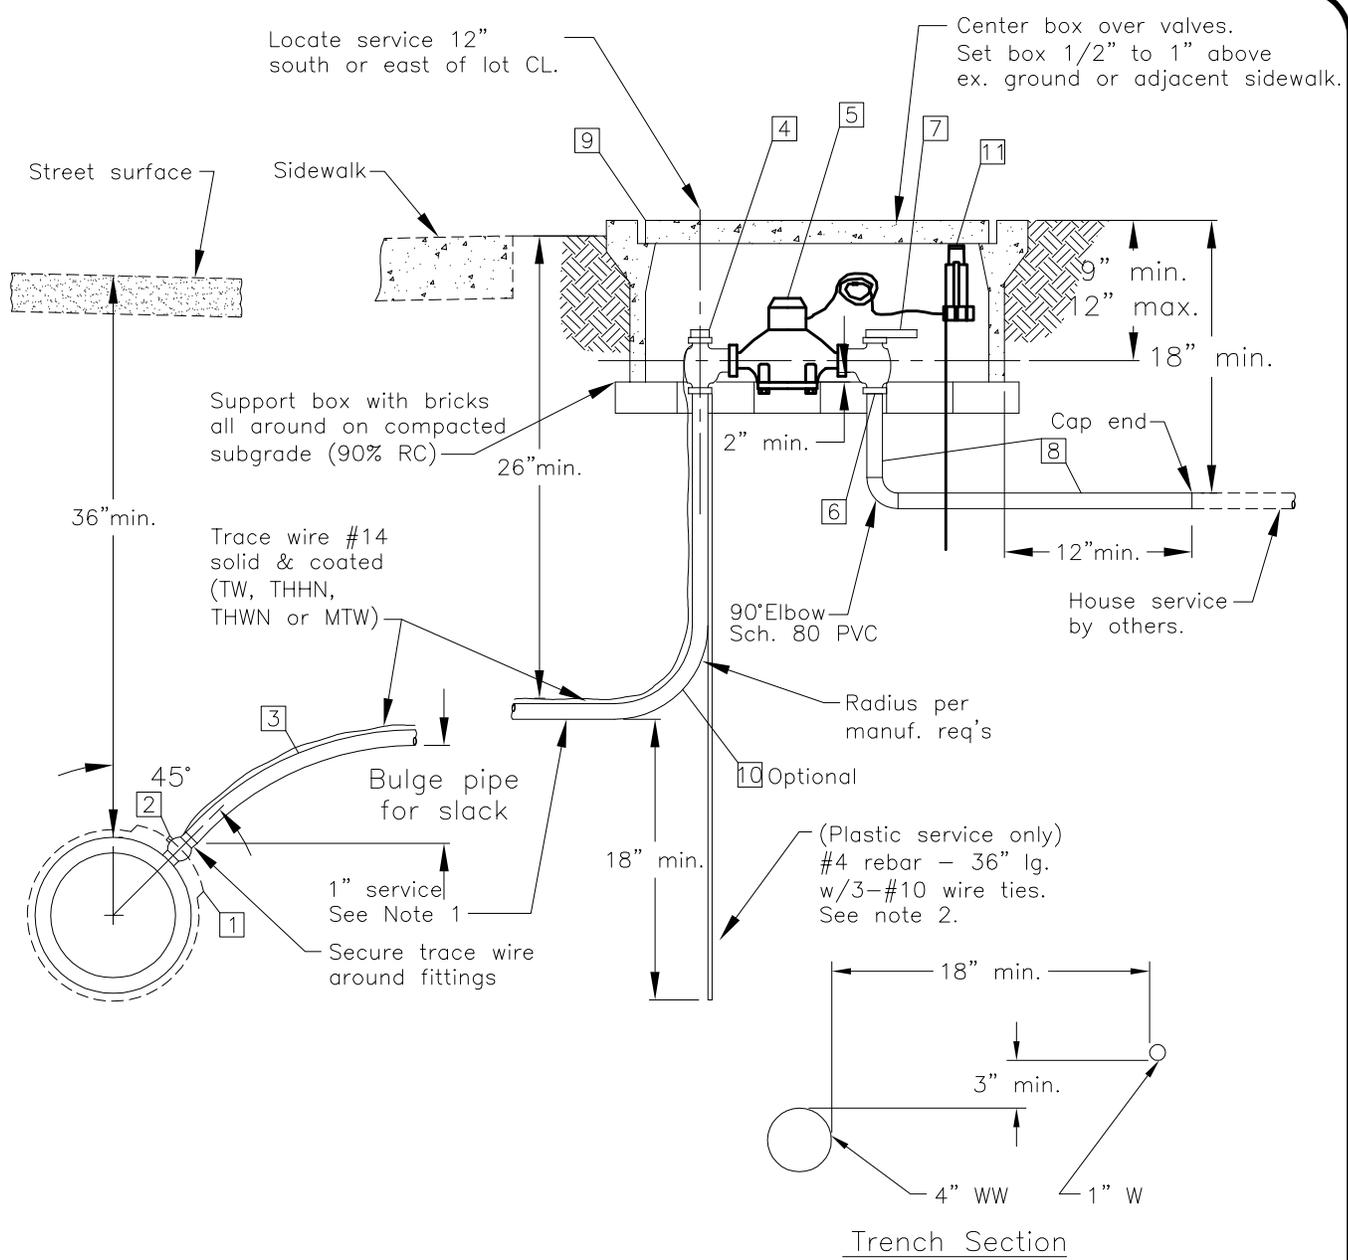

Notes:

- Maintain 24" clearance between tap and any coupling, fitting or adjacent tap. Plastic services shall be looped approximately 6" vertically or laterally to provide slack in the line. If the service is installed in the same trench as the sanitary service, the water service shall be installed without splices and the trench section shown applies.
- Backfill shall conform to Std. Plan 501.

Sheet 1 of 4

Dr.	KT	No.	Date	Revision	Appr.	Approved By:	STD PLAN
		2	2/05	REVERSED TRENCH SECTION		 F. Wally Sangrelin City Engineer R.C.E. 39895	403
Ch.	WS	3	10/05	ADDED METER & ERT			
Date		4	7/09	CHANGED CUSTOMER VAVLE			
						7/15/09	Date